


Part 2

Identification based adaptive systems

teoreetiline materjal: prof. Ennu Rüstern'i loengumaterjal "Ülevaade adaptiivsüsteemidest"

Structure of the control system

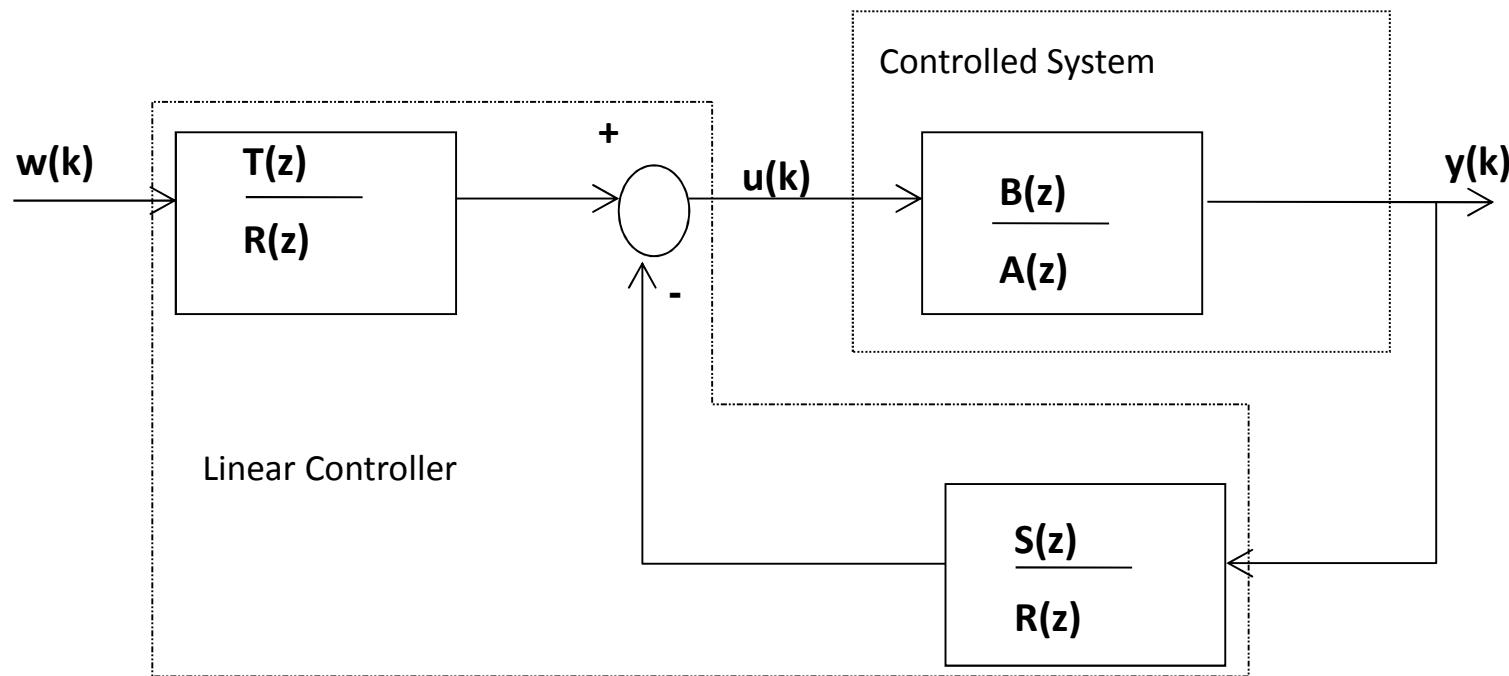

Control of a Linear System

Controlled System: $A(z)y(k)=B(z)u(k)$

Linear Controller: $R(z)u(k)=T(z)w(k)-S(z)y(k)$

Reference model: $A_m(z)y_m(z)=B_m(z)w(k)$

Closed loop system: $y(k) = \frac{B(z)T(z)}{A(z)R(z) + B(z)S(z)} w(k)$

Controller design criteria:

$$\frac{\mathbf{B}(z)\mathbf{T}(z)}{\mathbf{A}(z)\mathbf{R}(z) + \mathbf{B}(z)\mathbf{S}(z)} = \frac{\mathbf{B}_m(z)}{\mathbf{A}_m(z)}$$

Control of a 2nd order linear discrete time system

Controlled System:

$$A(z) = z^2 + a_1z + a_2$$
$$B(z) = b_1z + b_2$$

Reference model:

$$A_m(z) = z^2 + a_{m1}z + a_{m2} = (z - z_1)(z - z_2)$$
$$B_m(z) = b_{m1}z + b_{m2}$$

Linear controller:

$$T(z) = b_{m1}/b_1 z + b_{m2}/b_1$$
$$R(z) = z + b_2/b_1$$
$$S(z) = (a_{m1} - a_1)/b_1 z + (a_{m2} - a_2)/b_1$$

Recurrent estimation

Data vector:

$$\varphi^T(k) = [-y(k-1), \dots, -y(k-n); u(k-d-1), \dots, u(k-d-m)]$$

Parameter vector:

$$\hat{\Theta}^T(k-1) = [a_1, \dots, a_n; b_1, \dots, b_m]$$

Model:

$$y(k) = \varphi^T(k) \hat{\Theta}(k-1) + e(k)$$

Parameterestimation:

Where

$$\hat{\Theta}(k) = \hat{\Theta}(k-1) + K(k) [y(k) - \varphi(k) \hat{\Theta}(k-1)]$$

$$P(k) = \frac{1}{\lambda} \left(P(k-1) - \frac{P(k-1) \varphi(k) \varphi^T(k) P(k-1)}{\lambda + \varphi^T(k) P(k-1) \varphi(k)} \right)$$

$$K(k) = P(k) \varphi(k),$$

$P(k)$ and $P(k-1)$ are $(n+m) \times (n+m)$ covariance matrices of parameter estimations,

$K(k)$ is a vector of weighting coefficients,

$\lambda (\lambda < 1)$ is a memory coefficient.

2 order system's parameters estimation

Data vector: $\varphi^T(k) = [-y(k-1), -y(k-2); u(k-1), u(k-2)]$

Parameter vector: $\hat{\Theta}^T(k-1) = [a_1, a_2; b_1, b_2]$

Model: $y(k) = \varphi^T(k)\hat{\Theta}(k-1) + e(k)$

Parameter estimation: $\hat{\Theta}(k) = \hat{\Theta}(k-1) + K(k)[y(k) - \varphi(k)\hat{\Theta}(k-1)]$,


Here $P(k) = \frac{1}{\lambda} \left(P(k-1) - \frac{P(k-1)\varphi(k)\varphi^T(k)P(k-1)}{\lambda + \varphi^T(k)P(k-1)\varphi(k)} \right)$

$K(k) = P(k)\varphi(k)$,

$P(k)$ and $P(k-1)$ are 4×4 covariance matrices of parameter estimations,

$K(k)$ is a vector of weighting coefficients,
 λ is a memory coefficient ($\lambda < 1$).

Adaptive control

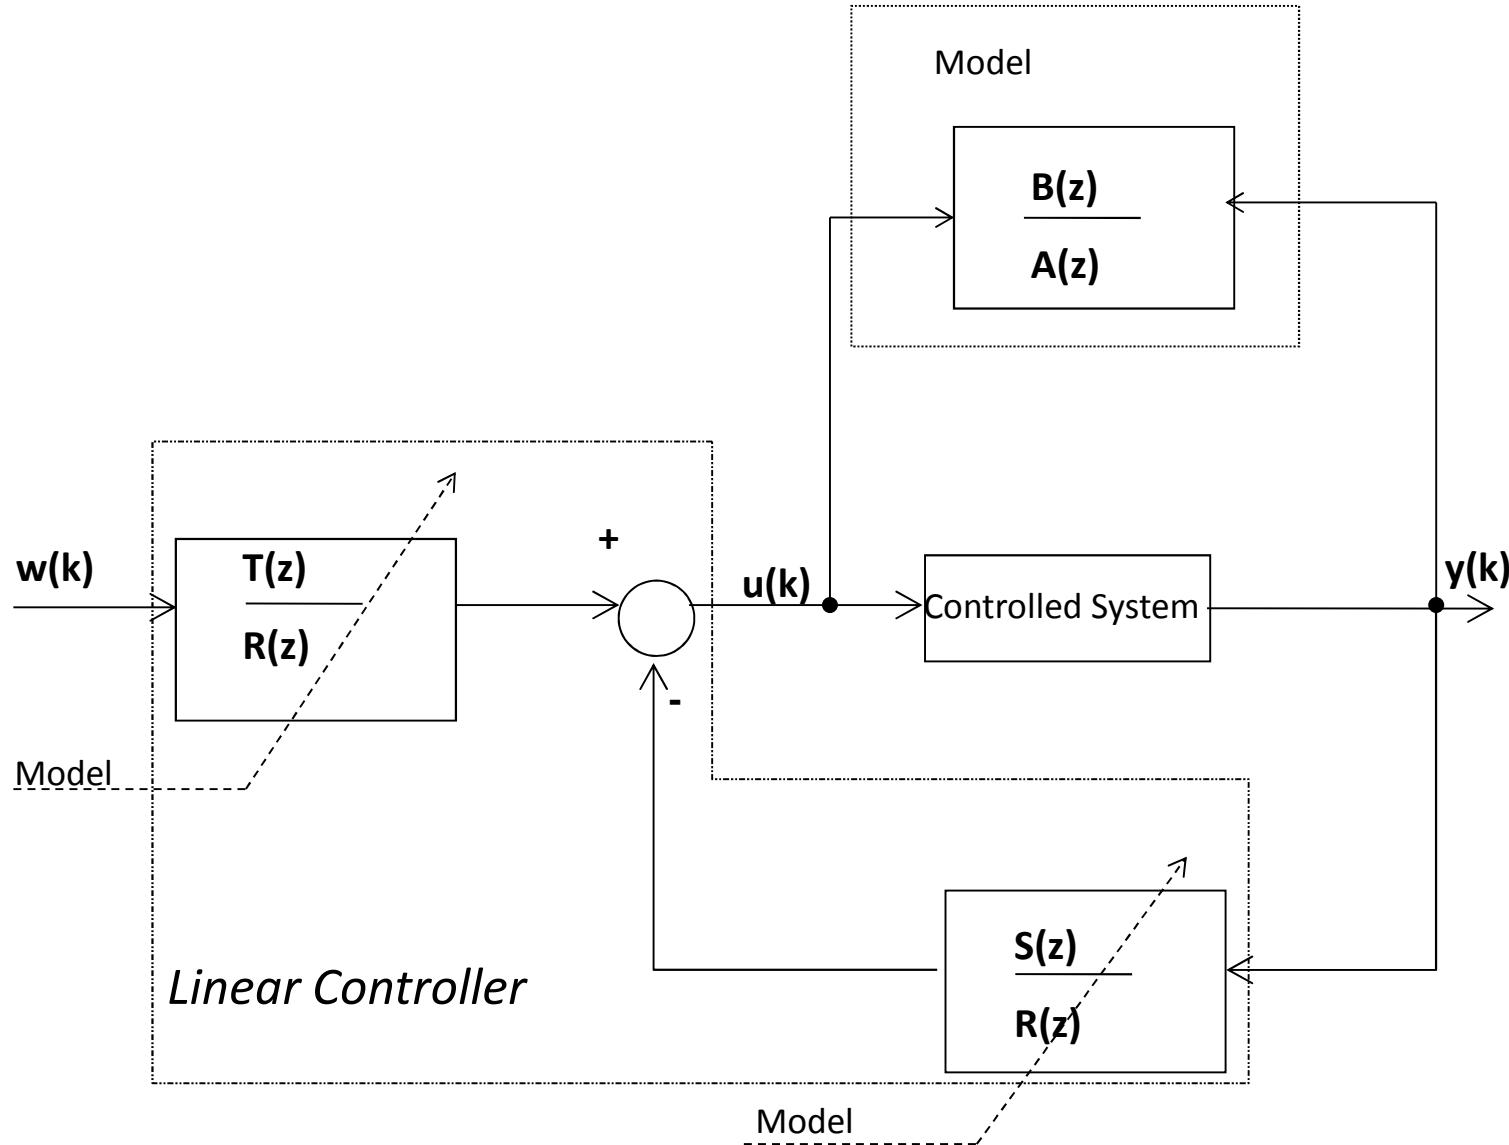

Test Plant

$$H(z) = \frac{z + 0.5}{z^2 - 1.5z + 0.5}$$

$$\begin{cases} a_1 = -1.5 \\ a_2 = 0.7 \\ b_1 = 1.0 \\ b_2 = 0.5 \end{cases}$$